



2500C-PS-24V-35 24VDC 35 Watt Power Supply



DESCRIPTION

The 2500C-PS-24V-35 is a triple wide module that provides power for the CPU and all IO modules plugged in the Compact Chassis.

FEATURES

- Triple wide module
- 24VDC Power Supply
- Maximum 35 watts backplane power
- 8 mSec holdup time
- Front accessible fuse

Power Supply Specifications		
Field Wiring Connector	3 Pin Removable Connector	
Input Voltage Operating Range	20 VDC to 30 VDC	
Total Wattage Rating	35 watts maximum output @ 0° to 60°C	
Steady State Input Current at full Load	2.2 Amps max @ 20VDC 1.78 Amps max @ 24VDC 1.4 Amps max @ 30VDC	
Peak Inrush Current	12.5 Amps max @ 24VDC	
Fusing	Littelfuse 0213005.MXP 250V IEC SLO 5x20mm 5A I2T=314	
Hold Up Time	8mSec @ 35 Watt Full Load	

Module Size	Triple wide module	
Isolation	1500VAC: 24 VDC-to-Backplane 500VDC: Chassis-to-Backplane 1500VAC: 24 VDC-to-Chassis IEC 60950-1	
Operating Temp Range	0°C to 60°C (32°F to 140°F)	
Storage Temperature	-40°C to 85°C (-40°F to 185°F)	
Relative Humidity	5% to 95% (non-condensing)	
Shipping Weight	2.0 lb. (0.91 Kg)	
Agency Approvals Pending	UL, ULC, FM(Class 1, Div 2), CE	



Note: The power should be turned off to the power supply before doing any maintenance. It must be noted that when the fuse is either blown or removed the CPU will go into a normal shutdown. Replacing the fuse with the power off guaranties the system will come up in an orderly fashion. Replacing the fuse while power is still on could create unpredictable restart issues.



Control Technology Inc. 5734 Middlebrook Pike, Knoxville, TN 37921-5914 Phone: +1.865.584.0440 Fax: +1.865.584.5720 www.controltechnology.com










2500C-PS-24V-35 24VDC 35 Watt Power Supply

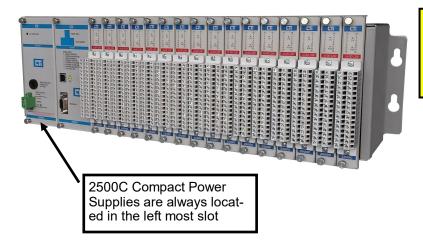

Warning:

Disable all power to the base before installing or removing the power supply. Failure to do so could cause damage to the equipment or injury to personnel.


Caution:

Do not attempt to operate the 2500C-PS-24V-35 out of the Voltage Operating Ranges specified. Damage to the Power Supply could occur if out of range power input is applied.



REMOVE PERFORATED CIRCLES TO RECOR MAR APR MAY JUN JUL AUG SEP OCT

Note: This label is found on the side of the power supply. It provides the user a way to record the date the power supply was put in service. Please visit our website for more



User Supplied Power Input Wiring Diagram Note: Use Copper Cunductors Only.

Installing Power Wiring

Use the following steps for installing and removing the 2500C-PS-24V-35 Power Supply from the 2500C Chassis.

- Position the power supply so that the bezel is facing you.
- Grasp the top and bottom of the power supply.
- Carefully slide the power supply into the left most slot in the base until it engages into the backplane connector.
- Strip power wiring back, insert the wire into the wiring connector as shown above, then tighten screws.
- Check to make sure the power input wires are securely inserted and the fastened in the wiring connector.
- Insert and tighten down the 3 pin removable wiring connector.
- Be sure to tighten the top and bottom bezel screws completely. 7.
- Once all the chassis modules including controllers and IO are inserted then you may apply power to the power supply

To remove the power supply, remove power from the power input by removing the power wiring connector or turning off the power source, loosen the bezel screws, and pull the power supply forward out of the chassis until it clears the chassis.



Control Technology Inc.

5734 Middlebrook Pike, Knoxville, TN 37921-5914 Phone: +1.865.584.0440 Fax: +1.865.584.5720 www.controltechnology.com



CE





2500C-PS-24V-35 24VDC 35 Watt Power Supply





CAUTION – Non-Hazardous Areas/Hazardous Areas

WARNING – EXPLOSION HAZARD. DO NOT REMOVE OR REPLACE WHILE CIRCUIT IS LIVE UNLESS THE AREA IS FREE OF IGNITIBLE CONCENTRATIONS.	AVERTISSEMENT – RISQUE D'EXPLOSION. NE PAS RETIRER NI REMPLACER PENDANT QUE LE CIRCUIT EST SOUS TENSION À MOINS QUE L'EMPLACEMENT NE SOIT EXEMPT DE CONCENTRATIONS INFLAMMABLES.
WARNING – EXPLOSION HAZARD. DO NOT REMOVE OR REPLACE FUSE WHEN ENER-GIZED.	AVERTISSEMENT – RISQUE D'EXPLOSION. NE PAS RETIRER NI REMPLACER UN FUSIBLE SI L'APPAREILLAGE EST SOUS TENSION.

Turn off power to the system before replacing fuses either in power supplies or IO modules. Refer to Product Bulletin or Installation and Operation Guide for specific information on the correct fuse for replacement. If there are any questions please contact CTI support. Fuses should only be replaced by qualified technicians.



Control Technology Inc. 5734 Middlebrook Pike, Knoxville, TN 37921-5914 Phone: +1.865.584.0440 Fax: +1.865.584.5720 www.controltechnology.com



 $C \in$





2500C-PS-24V-35 24VDC 35 Watt Power Supply

2500C Compact Modules Backplane Power Requirements			
Model #	Description	Backplane Power Budget	
2500C-C100	CPU, 128K	7 watts	
2500C-C200	CPU, 256K	7 watts	
2500C-C300	CPU, 512K	7 watts	
2500C-C400	CPU, 3072K	7 watts	
2500C-J750	JANUS Compact PAC CPU	7 watts	
2500C-2572-B	Fast Ethernet TCP/IP Adapter (100 Mbit) for Compact	2.5 watts	
2500C-RBC-PRF	Profibus Remote Base Controller	1.5 watts	
2500C-RBC-RS485	RS485 Remote Base Controller	1.5 watts	
2500C-16-DI-24V	16 Non-isolated 24 VAC/VDC Digital Inputs	1.2 watts (with all Inputs ON)	
2500C-16-DI-120V	16 Non-isolated 120 VAC/VDC Digital Inputs	1.2 watts (with all Inputs ON)	
2500C-16-IDI-120V	16 Isolated 120 VAC/VDC Digital Inputs	1.2 watts (with all Inputs ON)	
2500C-16-IDI-24V	16 Isolated 24 VAC/VDC Digital Inputs	1.2 watts (with all Inputs ON)	
2500C-8-IDO-120V	8 Isolated 120/240VAC Digital Outputs	1.09 watts (with all Outputs ON)	
2500C-8-IDO-24V	8 Isolated 24VDC Digital Outputs	1.09 watts (with all Outputs ON)	
2500C-16-DO-120V	16 120VAC Non-isolated Digital Outputs (Note Range is 79-132VAC)	1.25 watts (with all Outputs ON)	
2500C-16-DO-24V	16 24VDC Non-isolated Digital Outputs	1.25 watts (with all Outputs ON)	
2500C-8-RL-FC	8 Form C Relay Outputs	1.22 watts	
2500C-8-AI	8 Analog Inputs	.706 watts	
2500C-8-AO	8 Analog Outputs	.312 watts	
2500C-8-TC	8 Thermocouple Inputs	1.25 watts	
2500C-8-RTD	8 RTD Inputs	1.125 watts	
2500C-4-HSC	4 Channel High Speed Counter (Note: Release Date Target 2016)	TBD	

How to calculate the power requirements for the system.

Using the Table above find your module and the Backplane Power Budget Value. Add all the modules Power Budget Requirement that will be installed in the base to arrive at the expected power requirement for your system.



Control Technology Inc. 5734 Middlebrook Pike, Knoxville, TN 37921-5914 Phone: +1.865.584.0440 Fax: +1.865.584.5720 www.controltechnology.com



 ϵ